



Fire Extinguishers Inspection Report

Client:	DPAB Co.Ltd Iraq Branch Block-9	Job Number:	ATS-04-25-4953
Report Number:	ATS-04-25-4953-004	Location:	DQ Base – Basra / Block 9
Date of Inspection:	20- Apr-2025	Inspection Due Date:	19- Apr-2026

Relative Standard:	NFPA (National Fire Protection Association)- NFPA 10: Standard For Portable Fire Extinguisher
---------------------------	---

Environmental conditions during testing:	Humidity 41.0 % Rh ±3%	Temperatures Mean: 36.0°C ±5°C
---	------------------------	--------------------------------

#	Serial Number	Type	Weight	Re-filling	Condition		Remarks
					Acc.	Rej.	
1.	DQ-FE-076	Dry Powder	6 Kg	N/A	■	□	Accepted
2.	DQ-FE-077	Dry Powder	6 Kg	N/A	■	□	Accepted
3.	DQ-FE-078	Dry Powder	6 Kg	N/A	■	□	Accepted
4.	DQ-FE-079	Dry Powder	8 Kg	N/A	■	□	Accepted
5.	DQ-FE-080	Dry Powder	8 Kg	N/A	■	□	Accepted
6.	DQ-FE-081	Dry Powder	8 Kg	N/A	■	□	Accepted
7.	DQ-FE-082	Dry Powder	8 Kg	N/A	■	□	Accepted
8.	DQ-FE-083	Dry Powder	8 Kg	N/A	■	□	Accepted
9.	DQ-FE-084	Dry Powder	8 Kg	N/A	■	□	Accepted
10.	DQ-FE-085	Dry Powder	8 Kg	N/A	■	□	Accepted
11.	DQ-FE-086	Dry Powder	8 Kg	N/A	■	□	Accepted
12.	DQ-FE-087	Dry Powder	8 Kg	N/A	■	□	Accepted
13.	DQ-FE-088	Dry Powder	8 Kg	N/A	■	□	Accepted
14.	DQ-FE-089	Dry Powder	8 Kg	N/A	■	□	Accepted
15.	DQ-FE-090	CO2	6 Kg	N/A	■	□	Accepted
16.	DQ-FE-091	Dry Powder	50 Kg	N/A	■	□	Accepted
17.	DQ-FE-092	Dry Powder	35 Kg	N/A	■	□	Accepted
18.	DQ-FE-093	Water Based	25 L	N/A	■	□	Accepted
19.	DQ-FE-094	Dry Powder	35 Kg	N/A	■	□	Accepted
20.	DQ-FE-095	Dry Powder	50 Kg	N/A	■	□	Accepted
21.	DQ-FE-096	Dry Powder	25 Kg	N/A	■	□	Accepted
22.	DQ-FE-097	Foam	25 L	N/A	■	□	Accepted
23.	DQ-FE-098	Dry Powder	6 Kg	N/A	■	□	Accepted
24.	DQ-FE-099	Foam	6 L	N/A	■	□	Accepted
25.	DQ-FE-100	Dry Powder	2 Kg	N/A	■	□	Accepted


*This is to Certify That: a competent person did attend the above-mentioned owner's work location on the date shown above and the fire extinguishers described in this report have been Examined as per the requirements of NFPA10 Standard. The results at the time of Inspection found **satisfactory** and the above-mentioned extinguishers considered **safe** to continue in service.*

Fire Extinguishers Inspected By:

Hussein Alaa / Master Log Certificate (NEBOSH 0136995/38678)

Date: 20/April/2025

Signature:

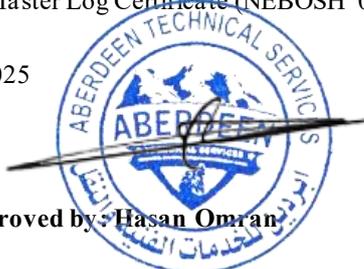

Reviewed & approved by: Hasan Omeran

